

# The Hose Monster Company

1330 Ensell rd, Lake Zurich, Illinois, 60047, Company Lic#:

## Hydrant Capacity Test (Single Hydrant)

05-08-2025 10:49 AM

Inspector: Patrick Spillane

Job Site Info:

JOB SITE: Music City Center  
STREET: 204 Rep John Lewis Way

CITY & STATE: Nashville, Tennessee

SITE CONTACT:

Customer Info:

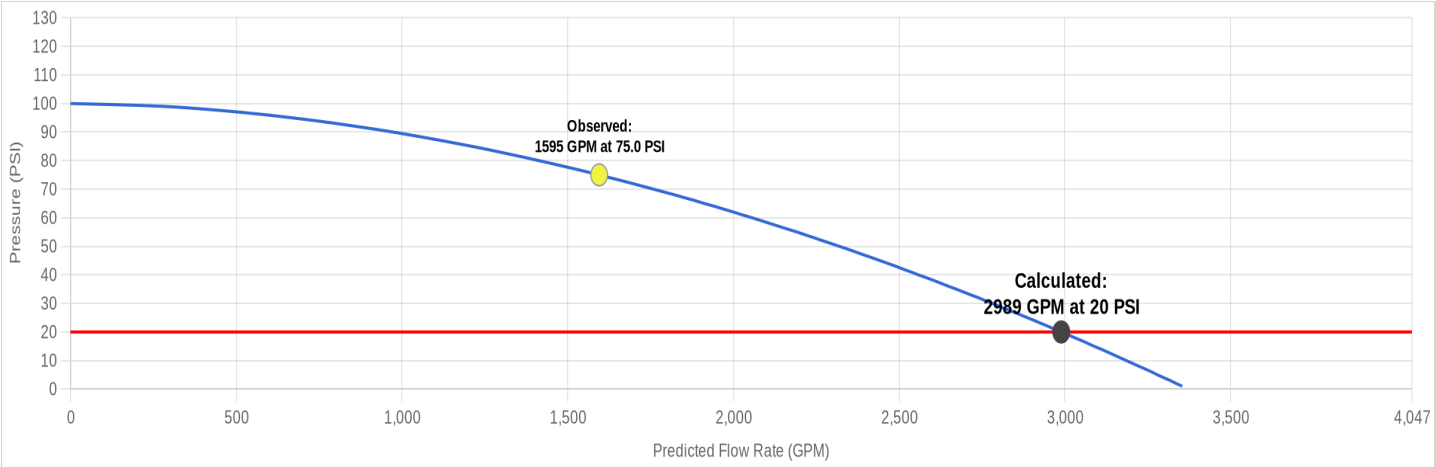
CUSTOMER: Hydro Flow Products, Inc.

STREET: 1330 Ensell rd.



CITY & STATE: Lake Zurich, Illinois

CUSTOMER CONTACT:

Test Hydrant:		Flow Hydrant	
Hydrant Name:	Hyd #1	✓ Same as Test Hydrant	
Barrel Type:	Wet Barrel	Hydrant Name:	Hyd #1
Make:	Mueller	Notes:	
Model:	Model Na	Flow Equipment	
Port #1:	2.5	Flow Port 1: HYD #1	BigBoy Hose Monster
Port #2:	2.5	Calculated Results	
Port #3:	4	GPM at 20 psi:	2989
Notes:		Class:	AA
Observed Flow		Marking Color:	Light Blue
Static Pressure:	100.0	Result:	Satisfactory
Residual Pressure:	75.0		
Flow Rate:	1595		
% Pressure Drop	25%		



## Hydrant Checklist

Wet Barrel Hydrants				
	Y	N	N/A	Notes
Is the hydrant accessible and visible? (vegetation needs 3ft clearance)	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
Is the hydrant free of leaks, cracks, and detrimental corrosion?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Leaking from bonnet 
Are the nozzle threads in good condition and lubricated?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Needs lube 
Is the operating nut and stem in good condition?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
Are the caps not excessively tight?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
Has the hydrant been flow tested within the last 5 years?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
Is the hydrant marked or color coded according to its fire flow capacity?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
Hydrant Isolation Valve				
	Y	N	N/A	Notes
Has the isolation valve been operated through the full range of motion?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
Has the valve been verified to be in the open position?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
Is the valve cover plate in good condition and marked accordingly?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	

Leaking From Bonnet



Needs Lube



# The Hose Monster Company

1330 Ensell rd, Lake Zurich, Illinois, 60047, Company Lic#:

## Hydrant Capacity Test (Single Hydrant)

05-08-2025 10:49 AM

Inspector: Patrick Spillane

### Job Site Info:

JOB SITE: Music City Center  
STREET: 204 Rep John Lewis Way  
S  
CITY & STATE: Nashville, Tennessee  
SITE CONTACT:

### Customer Info:

CUSTOMER: Hydro Flow Products, Inc.  
STREET: 1330 Ensell rd.  
CITY & STATE: Lake Zurich, Illinois  
CUSTOMER CONTACT:

## Jobsite Map



## Hydrant List

Hydant Name	Model	Barrel Type	Hydrant Class
HYD #1	Model NA	Wet Barrel	Light Blue AA